

RCP 40: Damper control unit

How energy efficiency is improved

Enables the implementation of individually optimised controls for maximum efficiency in pneumatic installations.

Areas of application

Activation of a temperature-dependent outside-air/return-air damper in combination with a transducer in ventilation and air-conditioning equipment. Control of the mixed-air temperature with two separate transducers, e.g. in winter operating mode.

Features


- Control of fresh air damper, depending on trapezium diagram for the outdoor temperature
- Housing, rack and front doors made of thermoplastic
- Suitable for wall or panel mounting
- Functional description and commissioning help inserted in front door
- Front panel with adjusters and 3 covered recesses for plug-in pressure gauge (XMP) making commissioning easier
- All settings very easy to make with a coin and % scale
- M4 measuring connections, control action adjustable (delivered with control action B)
- Compressed-air connections Rp 1/8" female thread
- Complies with directive 97/23/EC Art. 3.3 on pressure equipment

Technical description


- Supply pressure 1.3 bar \pm 0.1
- Easily accessible adjusters for KP₃₊₅ (schedule start point), XP₃₊₅ (P range)
- Inputs for:
 - control action
- Outputs for:
 - output pressure for damper drive



T03065



Y03247



Type	Description	Air Capacity l _n /h	Air consumption ¹⁾ l _n /h	Weight kg
RCP 40 F001	trapezium diagram	400	70	0,7
Supply pressure ²⁾	1,3 bar \pm 0,1	Permissible amb. temp.		0...55 °C
Input pressures	0,2...1,0 bar	Connection diagram		A02692
Output pressures	0,2...1,0 bar	Dimension drawing		M297100
Shift starting pt. KP ₃ , KP ₅	0...100%	Fitting instructions		MV 3247
P-band X _{P3} , X _{P5}	0...100%			
Minimum limiter B	0...100%			

Accessories

- 0297103 000** Additional bag of scales with 8 different scales according to the transducer used.
- 0297133 000** Universal scales for setpoint adjuster X_S; gradation 120, 80/160, 50/100, 30/60

1) Without transducer; air consumption for transducer connections 3 and 5 is 33 l_n/h more in each case.

2) See Section 60 on regulations concerning the quality of supply air, especially at low ambient temperatures.

Operation

The pressure at connections 3 and 5 is fed in each case to an amplifier with variable shift starting point KP (zero point) and variable P-band X_P (amplification). The amplifier at input 3 has control action A; the one at input 5 has control action B. Due to the following minimum selection, the smaller of the two amplifier outputs is always passed on. This forms a trapezoidal characteristic which can be rotated at the KP points (at 0 bar). Both characteristics are limited to a (variable) minimum value by the following limiter B.

In its main use, a transducer is fed to both inputs, e.g. for the control of a fresh-air damper dependent on outside temperature (trapezium diagram).

The fresh-air damper can also be controlled with dependency on two separate transducers, e.g. damper control dependent on outside temperature in summer, and control of the mixed-air temperature in winter.

По вопросам продаж и поддержки обращайтесь:

Волгоград +7 (8442) 45-94-42
Екатеринбург +7 (343) 302-14-75
Ижевск +7 (3412) 20-90-75
Казань +7 (843) 207-19-05

Краснодар +7 (861) 238-86-59
Красноярск +7 (391) 989-82-67
Москва +7 (499) 404-24-72
Ниж.Новгород +7 (831) 200-34-65

Новосибирск +7 (383) 235-95-48
Омск +7 (381) 299-16-70
Пермь +7 (342) 233-81-65
Ростов-на-Дону +7 (863) 309-14-65

Самара +7 (846) 219-28-25
Санкт-Петербург +7 (812) 660-57-09
Саратов +7 (845) 239-86-35
Сочи +7 (862) 279-22-65

Additional details

Front plate with adjusters for P-bands (X_{P3} , X_{P5}), shift starting point (KP3, KP5) and limitation (B).

Additional information on accessories


0297103 000 Additional bag of eight alternative scales
 5...35 °C 20...90 %rh
 -20...40 °C 0...5 mbar
 0...120 °C 5...10 mbar
 80...200 °C 10...15 mbar

Technical information


Technical manual: *centair system* 304991 003

Connection diagrams

Damper control for summer and winter

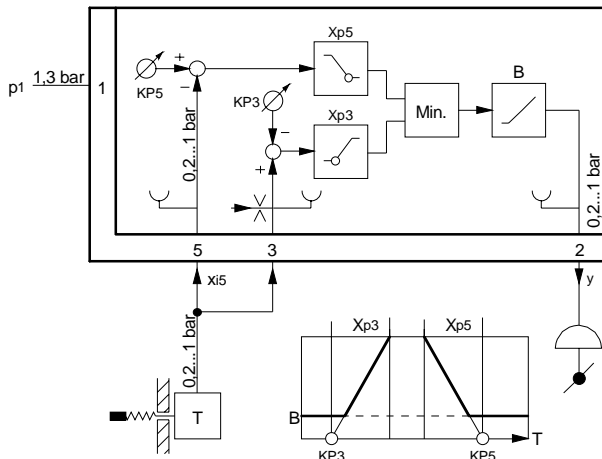


Open-loop control in summer, closed-loop control in winter

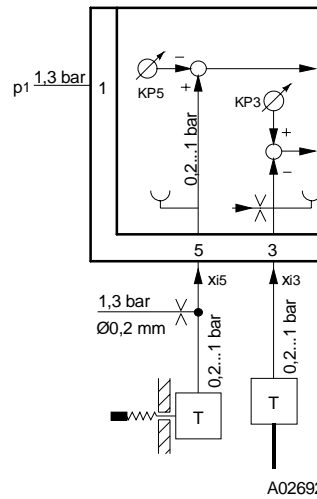

1	Supply pressure	KP3	Shift starting point, summer	B	Minimum limiter
2	Output pressure	KP5	Shift starting point, winter	x_{i3}	Mixed-air temperature
3	Input for control action A (winter)	X_{P3}	P-band, summer	x_{i5}	Outside temperature
5	Input for control action B (summer)	X_{P5}	P-band, winter	y	Output pressure

Dimension drawing

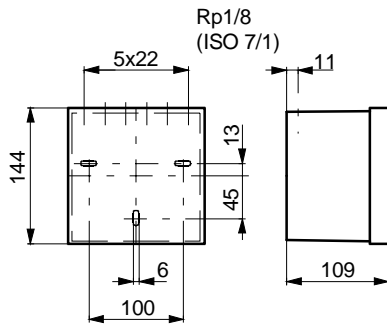

По вопросам продаж и поддержки обращайтесь:

Волгоград +7 (8442) 45-94-42
 Екатеринбург +7 (343) 302-14-75
 Ижевск +7 (3412) 20-90-75
 Казань +7 (843) 207-19-05

Краснодар +7 (861) 238-86-59
 Красноярск +7 (391) 989-82-67
 Москва +7 (499) 404-24-72
 Ниж.Новгород +7 (831) 200-34-65

Новосибирск +7 (383) 235-95-48
 Омск +7 (381) 299-16-70
 Пермь +7 (342) 233-81-65
 Ростов-на-Дону +7 (863) 309-14-65

Самара +7 (846) 219-28-25
 Санкт-Петербург +7 (812) 660-57-09
 Саратов +7 (845) 239-86-35
 Сочи +7 (862) 279-22-65